

INSTALLATION INSTRUCTIONS INSTRUCTIONS D'INSTALLATION **INSTALLATIE INSTRUCTIES** INSTRUCCIONES DE INSTALACIÓN **INSTALLATIONSANLEITUNG INSTRUKCJE INSTALACJI** INSTRUÇÕES DE INSTALAÇÃO

6.6/10W 1000/1500LM 3HR NON-MAINTAINED **IP65 6500K MANUAL & SELF-TEST** SWITCHABLE - ILEMBH031 NEW VERSION

EMERGENCY HIGH BAY BULKHEAD

















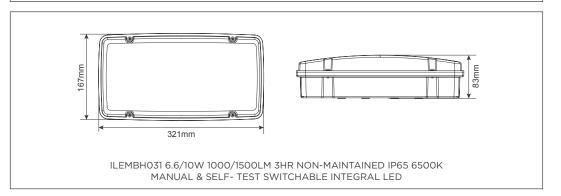



Routine Testing


Testing should be carried out in accordance with the recommendations of BS5266 & EN50172.


- 1. Do not switch off unswitched mains supply after installation. If interruption is unavoidable, the batteries must be disconnected or damage to the batteries may occur. Leave the luminaire on continuous charge for 24 hours.
- 2. Batteries should be replaced when the luminaire no longer meets the 3 hours duration performance.
- 3. Testing is performed by interrupting the unswitched supply for the test duration manually or self-test function complying with IEC62034. During testing the luminaire should remain illuminated in emergency mode.
- 4. Ensure that the 'charge indicator' is 'ON' during 'Charging Mode'. If the charge indicator (LED) is Unlit/red, this
- 5. Replace faulty light source and batteries immediately.

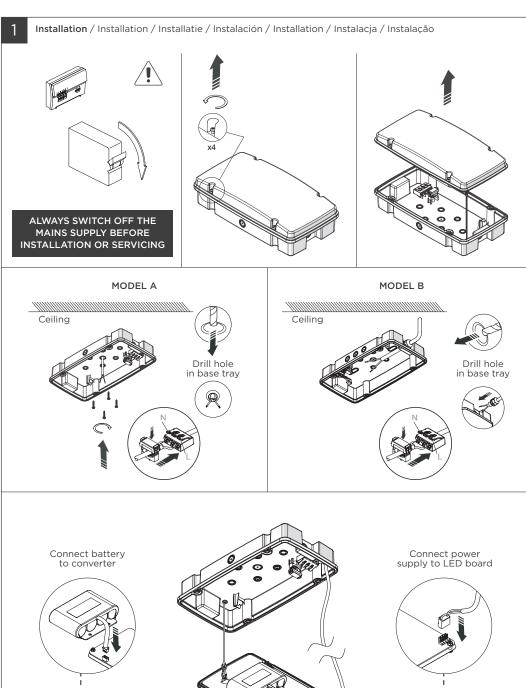





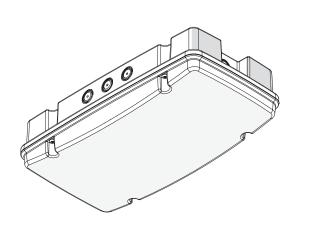



Specifications for Self Test

Function Test

The function test is carried out every week for 5 seconds. It will check the connection of battery, battery discharging and the connection of LED module.

Duration Test

atest is carried out for 3 hours every half year, on one day within the 175th day to the 195th day. It will also check the connection of battery and LED module.

A bi-colour indicator will indicate the normal and abnormal status. Green is for conditions are normal and red for failures.

Descriptions as following.

LED Colour	Status		On Time (Seconds)	Off Time (Seconds)	Description
Green		Permanent on	1	1	Normal status when mains connected
		Slow flash	1s	1s	Duration test running
	*	Fast flash	0.2s	0.2s	Function test running
	*	Normal flash three times only	0.5s	0.5s	Time reset
Red		Permanent on	1	1	Battery failure
		Slow flash	1s	1s	Lamp failure
	*	Fast flash	0.2s	0.2s	Duration failure - battery capacity is not sufficient.
Light Off		Off	1	1	Emergency mode

A test switch is applied for different functions activated manually.

Duration	Function	
Press for <2s	Simulate emergency mode	
Press for 3-5s	Start duration test manually. The test can be aborted by pressing off (1-2s).	
Press for 5-8s Start Function test manually for 60s. The test can be aborted by pressing off (1-2s).		
Press for >10s	Time Reset	

Note:

- 1. When the mains is on, the green indicator will be permanent on. It will check the connection of battery and the connection of LED module. When the mains is off, no test will perform.
- 2. When there is a lamp failure at non-maintained mode, the indicator remains green but will turn red and be slow flashing after the failure is detected in a weekly function test.
- 3. The luminaries on which we want to perform the duration tests must be connected to the mains supply for at least 24 uninterrupted hours.
- 4. When the fault is corrected, the indicator will only be reset to its normal status after mains reconnected or test switch pressed.
- 5. An accuracy of the timing of the test interval is ensured that it has an accuracy of ±75 s per week. The timing function will be retained through periods of mains supply failure or interruption for up to 7 days.
- 6. The battery charge shall not start if the cell temperature is below 0°C or above 65°C.



Integral LED is a division of Integral Memory plc: Unit 6, Iron Bridge Close, Iron Bridge Business Park, London, NW10 OUF, UK Integral Europe BV, 2801 DG, NL

IS1025 A

Warranty/Technical & contact information is available at www.integral-led.com

All Trademarks Acknowledged





